

Modeling and Reliability Assessment for Rainwater Harvesting System

*Thamer Ahmad Mohammad, Megat Johari Megat Mohd. Noor,
and Abdul Halim Ghazali*

Department of Civil Engineering, Faculty of Engineering,
Universiti Putra, Malaysia Selangor, Malaysia

Abstract

Rainwater harvesting is the technique of capturing the rainfall to meet some water needs in both urban and rural areas. The volume of rainwater collected from rainwater harvesting system varies from place to place and depends mainly on the climatic condition. Typically, the rainwater harvesting system is composed of the catchment (roof), gutter, rainwater pipe, and storage tank. Reliability of a rainwater harvesting system mainly depends on the collected volume in rainwater storage tank and it is also used to check whether the collected volume of rainwater can meet a specific water demand (either for potable or non-potable uses).

In the present study, a rainwater harvesting system is installed at the Faculty of Engineering, University Putra Malaysia. The system is tested using data from 24 different rain events. The collected data includes rain depth and rainwater volume. It is found that the rainwater volume ranges from 0.027 m³ to 4.03 m³. The actual data is used to produce an empirical model for predicting the collected rainwater volume. Calibration and validation processes are conducted to the proposed model and T-test shows that the model prediction is within 95% level of confidence.

Also, the water consumption for toilet flushing is monitored using water meter. Reliability of the installed rainwater harvesting system for toilet flushing is computed. It is found that the system reliability ranges from 26.61 % to 100 % depending on daily water demand and recorded rainwater depth.

Keywords: Rainwater Harvesting, System Modeling, Assessment, Reliability

Introduction

Rainwater harvesting is the technique of collection and storage of rainwater from roofs during rain events for future use. This technique is appropriate in many countries such as United Kingdom, Germany, China, Japan, Thailand, Sri Lanka, India, Australia, Brazil and United States of

America. The technique is relevant in areas with sufficient rainfall for collection but experiencing water shortage due to either limited availability of conventional water resources or due high water demand. It can also be used in arid regions to overcome water shortage.

Rainwater can be used to meet part of domestic water demand including both potable and non-potable. In urban areas, at a household level, rainwater can be used for flushing toilets, watering gardens and washing floor and these uses are known as non-potable. While in rural areas, it becomes the main source of water for potable uses which include drinking, bathing, and cooking. In rural areas it is recommended to treat the collected rainwater prior to use particularly if it is intended to be used for drinking.

A simplified rainwater harvesting system consists of a storage tank which is usually connected to a rooftop through a pipe. Rooftops are constructed from various types of materials such as concrete slab, plastic corrugated sheets, metal corrugated sheets, corrugated cement tiles and corrugated clay tiles. The collection areas of rainwater harvesting systems are buildings roof. The size of the roof varies from one type of building to another. Small roof size or catchment usually found in houses and large size is found in super markets and airports. The size of catchment has a direct influence on the collected rainwater volume from a catchment. Also, the intensity of the rainfall is another factor affecting the collected volume of rainwater.

Many rainwater harvesting systems were installed in many countries including Malaysia but the main concern is the reliability of these systems. The reliability mainly depends on collected rainwater volume and related to the nature of water consumption (for potable and non potable uses).

Shaaban et al. (2002) tested the usage of rainwater harvesting installed in a house located in Kuala Lumpur, Malaysia and according to the experiment done he recommended to use the rainwater mainly for washing clothes and flushing toilets.

Ruslan (2003) proposed a computer software for determining the reliability of rainwater tank. Also Ghisi and Ferreira (2006) studied the reliability of rainwater harvesting for 26 cities in Brazil.

Gould and Nissen-Peterson (1999) gave the runoff coefficients for various materials used for roofing. Rahman and Fatima (2006) and Handia et al. (2003) reviewed the materials of rainwater storage tank.

In this study, an empirical model is proposed for sizing the tank for rainwater harvesting system. The model is calibrated and validated using actual data. Data for water consumption in a student toilet is used to check the reliability of the rainwater harvesting system.

System Description and Methodology

In this study, a rainwater harvesting system is installed at a selected site at the Faculty of Engineering, Universiti Putra Malaysia. The system is composed of roof (catchment), gutter, PVC pipe and storage tank. The roof (catchment) size is 150 m² and it is made of corrugated steel sheets and sloped towards the gutter. The gutter is made of steel and fixed tightly with the

roof and its dimensions are 140 mm x 140 mm (width x depth). The diameter of the PVC pipe is 100 mm and it contains a piece of flexible hose and this arrangement can be used to collect samples of rainwater for quality monitoring. The pipe is connected to the storage tank from the top. The storage tank is made of steel and contains drain and depth monitoring scale. The dimensions of the tank are 0.85 m x 4.0 m x 1.2 m (width x length x depth) and its maximum capacity is 4.08 m³. A graduated scale is used to calculate the tank volume while the drain is used to empty the tank after rain in order to prepare the tank for next rain event. Figure 1 shows general view for tank while Figure 2 shows the roof and the gutter. Figure 3 shows the plastic pipe connections.



Figure 1: General view for the tank

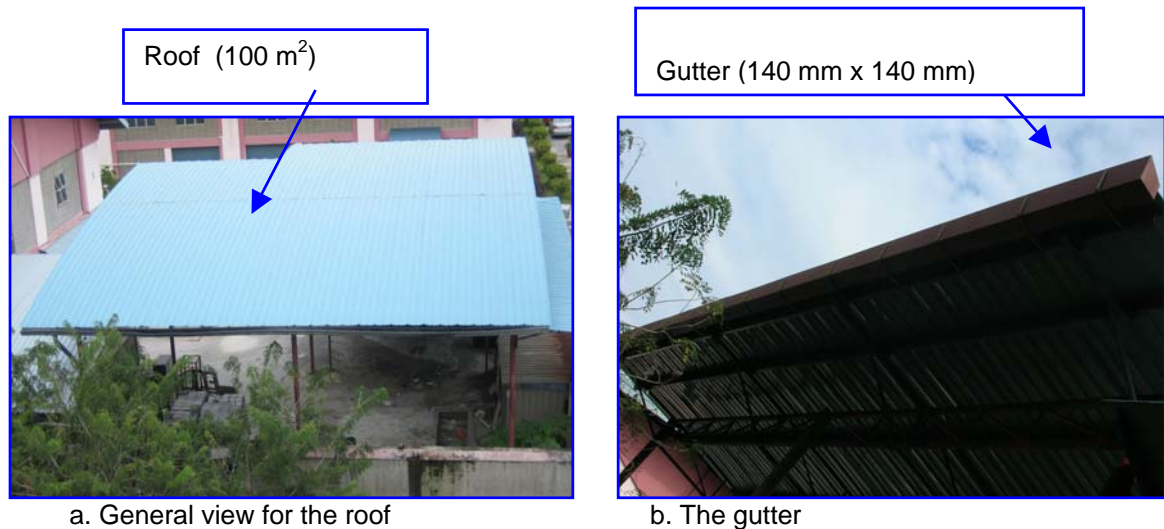


Figure 2: The rainwater catchment and gutter



a. Rainwater pipe



b. Flexible hose

Figure 3: Rain pipe connections

Beside the collection of rainwater volume in the tank, a rain gage is installed near the location of the system to get the rainfall record. Rainfall record for the period of the study is used to get a model simulating the system as well as to compute runoff coefficient for roof (catchment).

A meter is installed in one of the student wash rooms in order to get daily water consumption for toilet flushing. Data is collected continuously for 3 months (from January to March 2008). Furthermore, the numbers of students using the washroom is also monitored for one week. This type of data is needed for conducting reliability assessment to the system. The methodology of the study can be summarized in the flowchart shown in Figure 4.

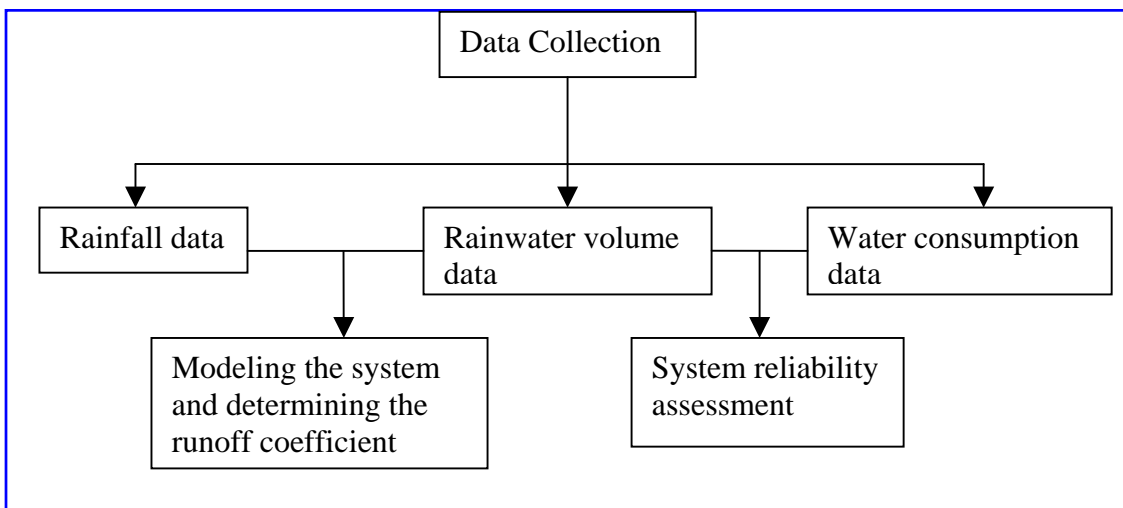


Figure 4: The methodology of the present study

Results and Discussion

In this study, rainfall data was collected for 8 months (from August 2007 to March 2008). In order to eliminate the effect of areal distribution of rainfall, a rain gage is installed nearby the location of rainwater harvesting system. This arrangement will help to increase the reliability of the results obtained from the system. Figure 5 shows total monthly rainfall and number of rainy days at the site of rainwater harvesting system for the above mentioned period. From the collected data, the maximum recorded monthly rainfall is 412 mm while the minimum recorded monthly rainfall is 40 mm. Also, the maximum number of rainy days is 21 and it is occurred in October 2007 while the minimum number of rainy days is 3 and it is occurred in February 2008. Thus, the average monthly rainfall depth is 223 mm while the average rainy days are 16.

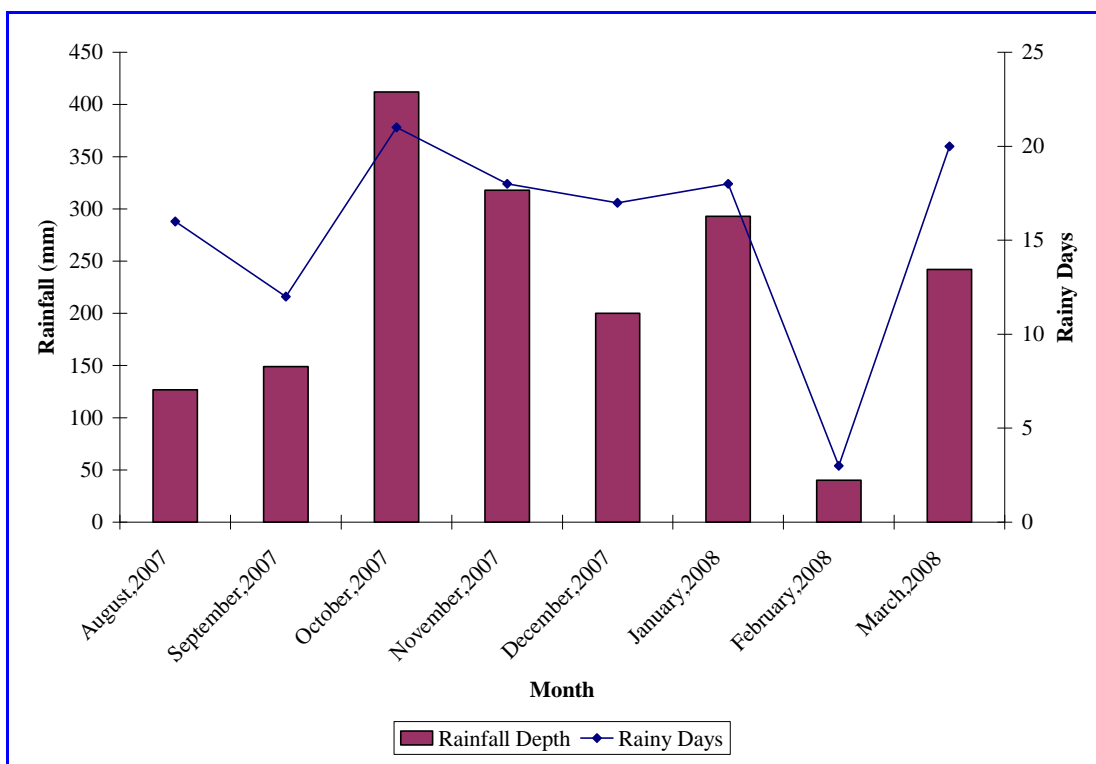


Figure 5: Monthly rainfall (mm) and rainy days from August 2007 to March 2008

The volume of rainwater collected in the tank of the rainwater harvesting system is recorded for every rain event for a period of 3 months (from January 2008 to March 2008). The volume of rainwater collected in the tank can be determined using the following formula:

$$V_R = D \times L \times W \quad (1)$$

where, V_R is the rainwater volume collected in the tank, D is the depth of water in the tank of the system, L is the tank length and W is the tank width.

For every rain event, the value of V_R is determined. Depending on the rainfall intensity and duration, it is found that the volume of rainwater collected

in the tank varies and ranges between 0.027 m³ and 4.026 m³. The maximum volume was collected on the 4th January while the minimum volume was collected on the 12 March 2008. From rainfall record, it is found that the shortest duration of rain is 15 minutes which is recorded on 25 January 2008 and rainwater volume collected from this event is 0.136 m³. On the other hand, the longest duration of rain is 150 minutes (2 hour 30 minutes) which is recorded on 13th January 2008 and the rainwater volume collected from this event is 1.438 m³. Figure 6 shows the variation of the collected volume of rainwater with the duration of the rainfall for various events.

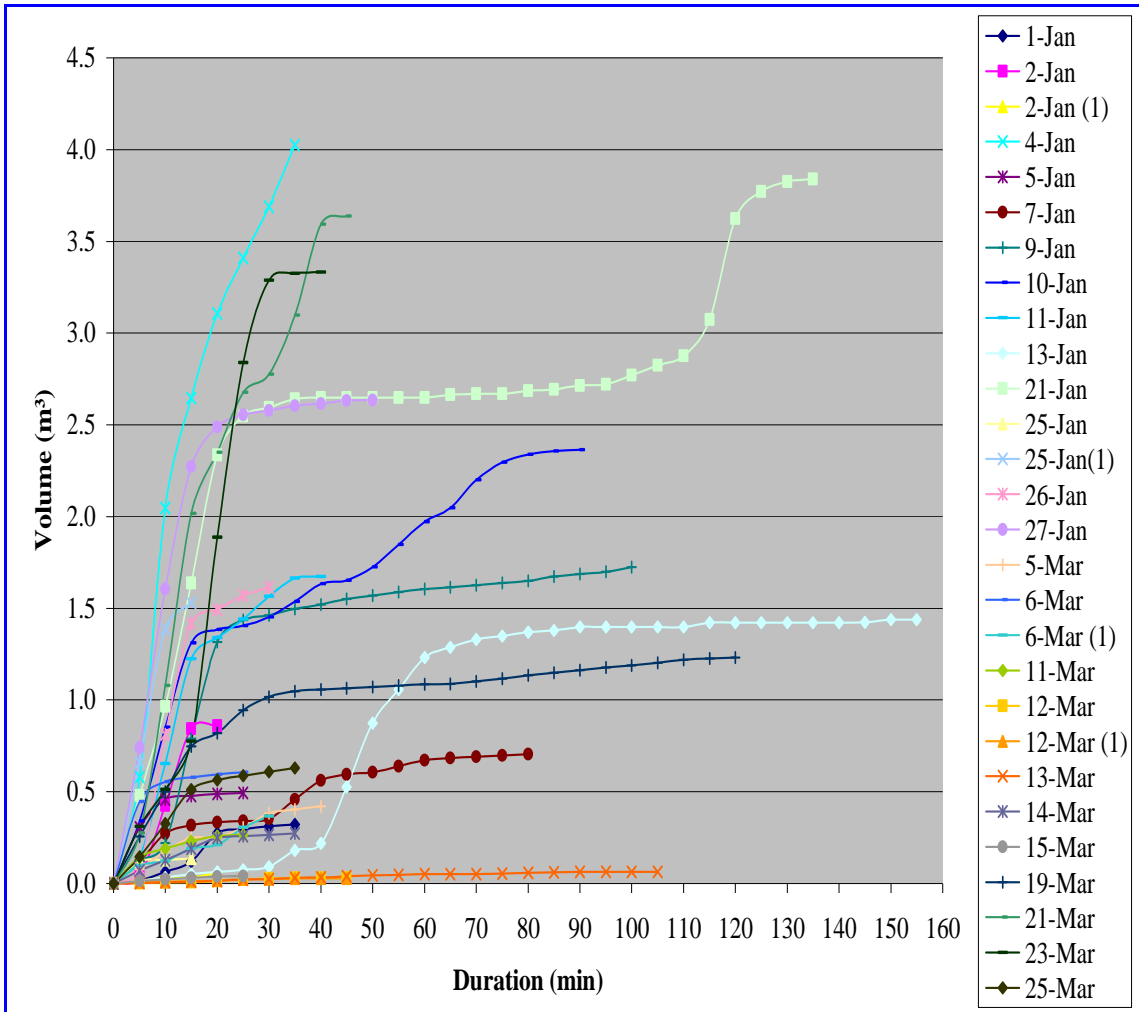


Figure 6: Variation of rainwater volume with time for various rain events

The collected data (volume of the rainwater, rainfall depth, duration and roof area) can be used to determine the runoff coefficient of the roof (catchment). The rational formula described below is used for this purpose.

$$Q = \frac{CIA}{360} \tag{2}$$

where C is the coefficient of runoff (dimensionless), Q is the collected runoff (m³/s), I is rainfall intensity (mm/hr) and A is the roof area (hectare).

For a given system, the size of the roof area is known and value of C depends on the type of roof material. So, Equation (2) can be written in the following general form:

$$Q = KI \tag{3}$$

where K is a constant and its value can be determined from the graphical relationship between Q and I.

For the system employed in the present study and based on the collected data, the graphical relationship between of runoff and rainfall is shown in Figure 7.

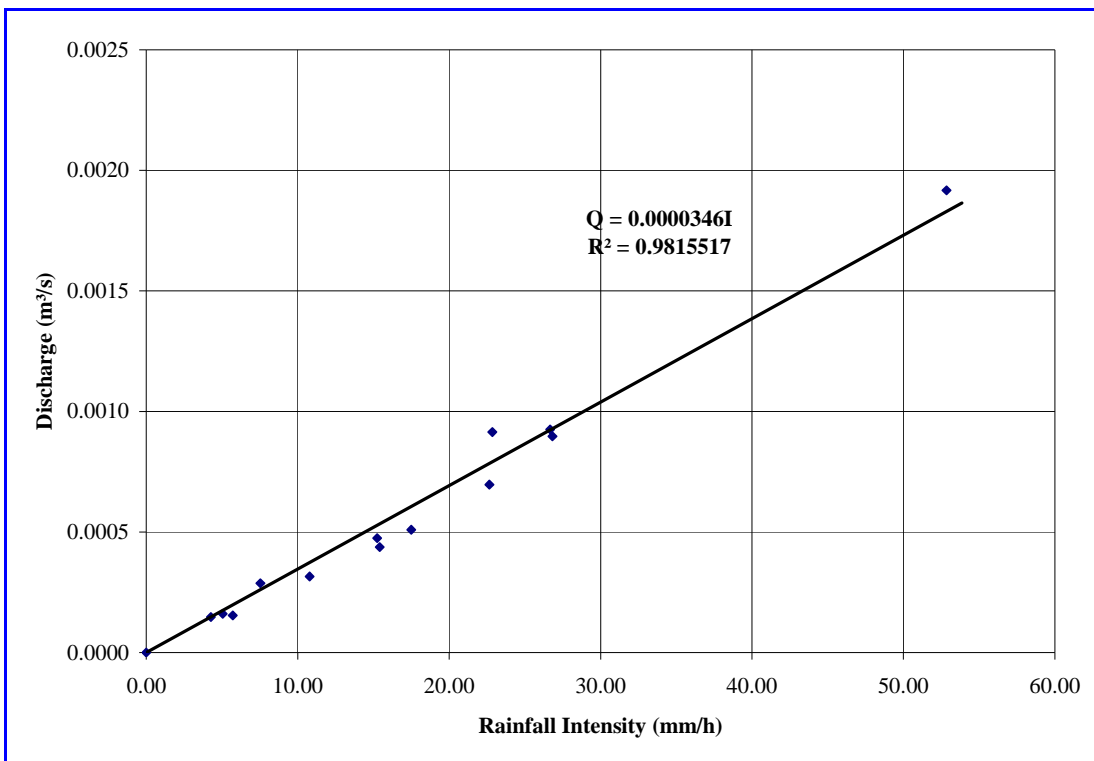


Figure 7: Relationship between rainfall and runoff for the rainwater harvesting system

Form Figure 7, the relationship between Q and I is linear and can be described as:

$$Q = 0.0000346I \tag{4}$$

From Equation (4), it can be concluded that the value of K is equal to 0.0000346 and the value of K can be described as:

$$K = \frac{CA}{360} \tag{5}$$

After substituting the values of A and K in Equation (5), the value of C is found to be 0.83. The value of runoff coefficient, C for the system in present study is in agreement with the value proposed by Zhu and Liu (1998). The values of runoff coefficient for roof catchment of sheet metal as recommended by Zhu and Liu (1998) range from 0.8 to 0.85. The value of C indicates that type of roof material used in the rainwater harvesting system is corrugated metal. It is recommended that similar studies to find values of C for the common types of roof materials used in Malaysia are carried out.

Based on equations (2) and (4) the following general model can be proposed to simulate the relationship between the rainwater volume and the rainwater depth for a rainwater harvesting system.

$$V_R = \phi d \quad (6)$$

In the present study, the collected data is divided into two equal parts. The first part is used to calibrate the model while the second part is used to validate the model.

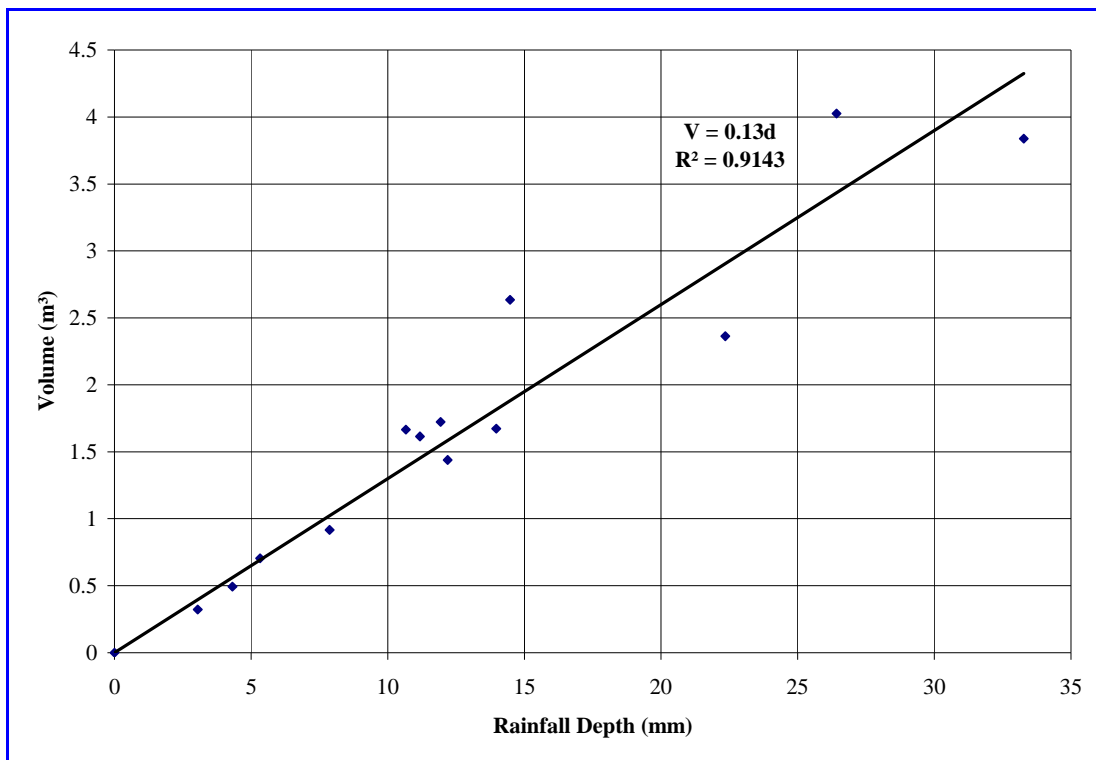


Figure 8: Relationship between the rainwater volume and rainwater depth for the studied system

From Figure 8, the value of ϕ is found to be 0.13. Thus, Equation (6) can be written as:

$$V_R = 0.13d \quad (6)$$

The coefficient of determination for the model described in Equation (6) is found to be 0.91. The model is very essential for designers involved in sizing the tank of rainwater harvesting system for housing and public buildings in Malaysia.

Using second part of the data, the proposed model is used to predict the rainwater volumes. Then the predicted volumes are compared with the recorded volumes (Figure 9). Generally, both predicted the recorded volumes are in agreement.

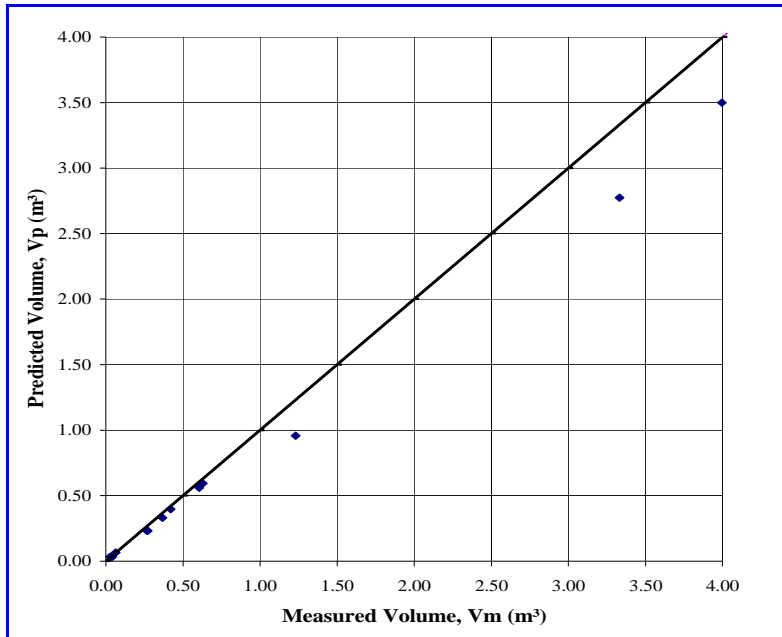


Figure 9: Comparison between the predicted and observed rainwater volumes

The absolute error (E_A) between the predicted rainwater volume (V_p) and the recorded rainwater volume (V_m) is determined using the following equation:

$$E_A = V_p - V_m \quad (7)$$

Equation (7) is used to verify the model accuracy and the values of absolute errors is shown in Table 1. It is found that the absolute error ranges between 0.0014 m³ to 0.5583 m³. In addition, t-test is performed for two samples (predicted and observed) and it is found that tested samples are within 95% confidence level.

Table 1: Absolute error for the predicted rainwater volume

Date	Rainwater Depth (mm)	Predicted Volume (m ³)	Recorded Volume (m ³)	Absolute Error (m ³)
05.03.2008	3.048	0.3962	0.3962	0.0254
06.03.2008	4.318	0.5613	0.5613	0.0439
06.03.2008	2.54	0.3302	0.3302	0.0370
11.03.2008	1.778	0.2311	0.2311	0.0341
12.03.2008	0.254	0.0330	0.0330	0.0024
12.03.2008	0.254	0.0330	0.0330	0.0058
13.03.2008	0.508	0.0660	0.0660	0.0014
14.03.2008	1.778	0.2311	0.2311	0.0409
15.03.2008	0.254	0.0330	0.0330	0.0078
19.03.2008	7.366	0.9576	0.9576	0.2732
21.03.2008	26.924	3.5001	3.5001	0.4949
23.03.2008	21.336	2.7737	2.7737	0.5583
25.03.2008	4.572	0.5944	0.5944	0.0346

Water consumption for flushing toilet is monitored using water meter for the period of three months (from January 2008 to March 2008). Figure 10 shows the variation of daily water consumption. Through the monitoring period, it is found that the maximum and minimum daily water consumptions are 4.3 m³ and 0.036 m³ respectively. From the collected data it is found that the average daily water consumptions is 0.85 m³ for month January 2008 while the average daily consumptions for months February and March 2008 are 0.88 m³ and 1.02 m³ respectively. For a selected day, water consumption for flushing toilet is monitored and Figure 11 shows the variation of the consumption. This observation was done for a period from 8 am to 8 pm on the 5th March 2008. The total measured volume of water consumed is found to 1.07 m³ and the total number of the students used the toilet is 101.

Figure 12 shows the mass curve for demand (water consumption for toilet flushing) and supply (rainwater volume collected in the tank) for month of January 2008. During the month of January, there are 5 days where the demand met the supply and this means that the collected rainwater volume is enough to meet the demand. Also, there are 3 periods along the month where the water demand exceeds the water supply and this means that the collected rainwater volume is not enough to meet the volume needed to flush the toilet but it is contributed to fulfill part of the demand. Based on this result, a dual system is very helpful to make use of rainwater and reduce the demand on public water supply. The total water demand throughout the month is 26.39 m³ whereas the total water supply from rainwater is 23.4 m³. It indicates that the rainwater volume can meet 89% of the demand for this month. The mass curves for months February 2008 and March 2008 are shown in Figures 13 and 14. In month February 2008, only 18.5% of the demand can be met but in month March 2008 the supply is 21% greater than the demand and this means that there is surplus of water for next month.

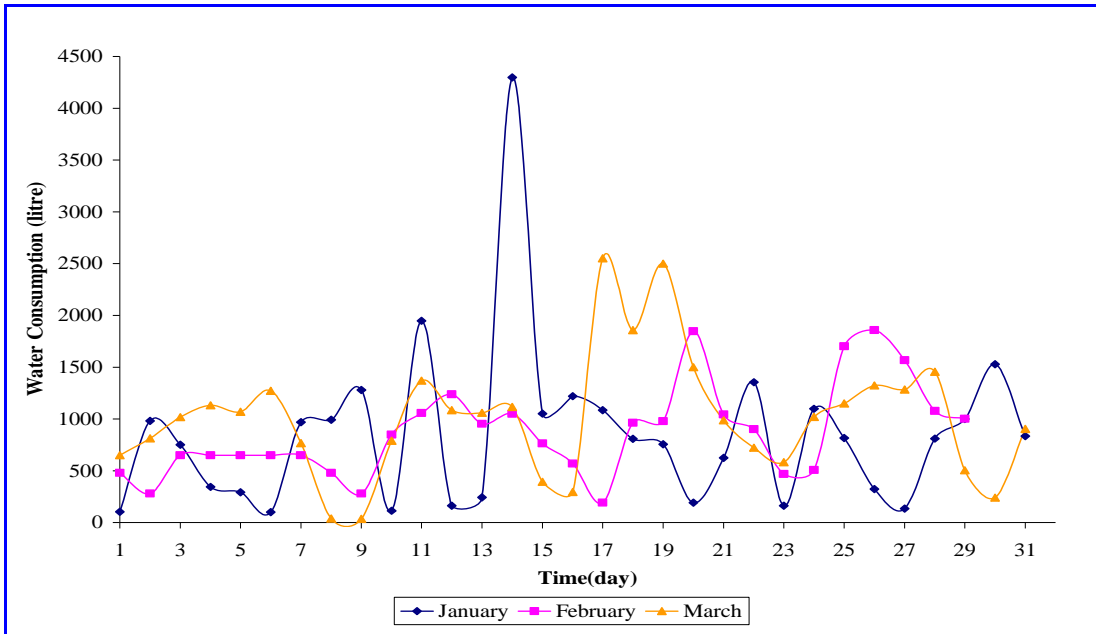


Figure 10: Variation of daily water consumption for flushing toilet

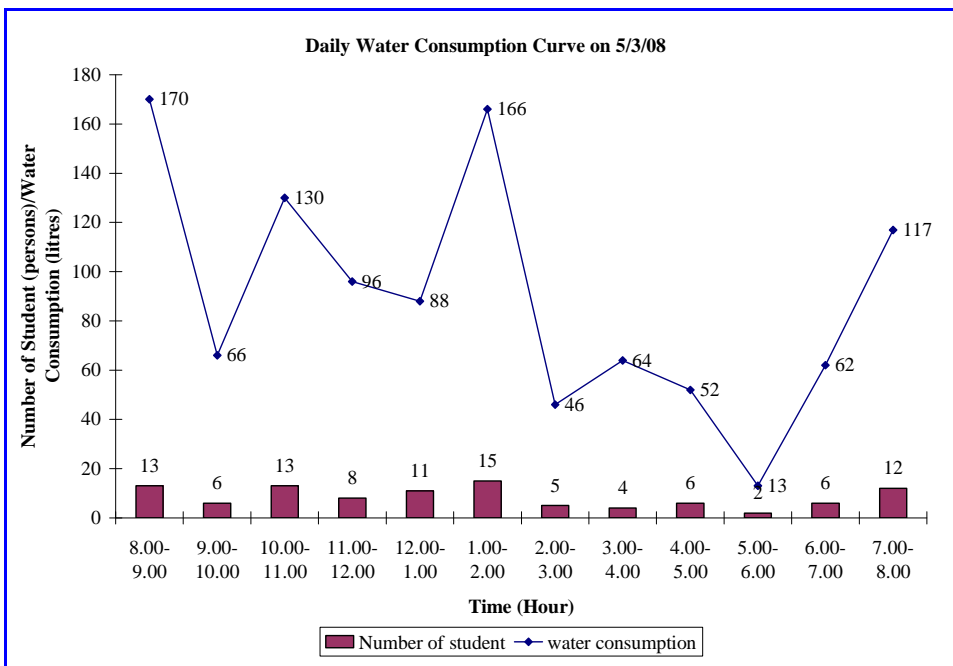


Figure 11: Variation of water consumption with number of users

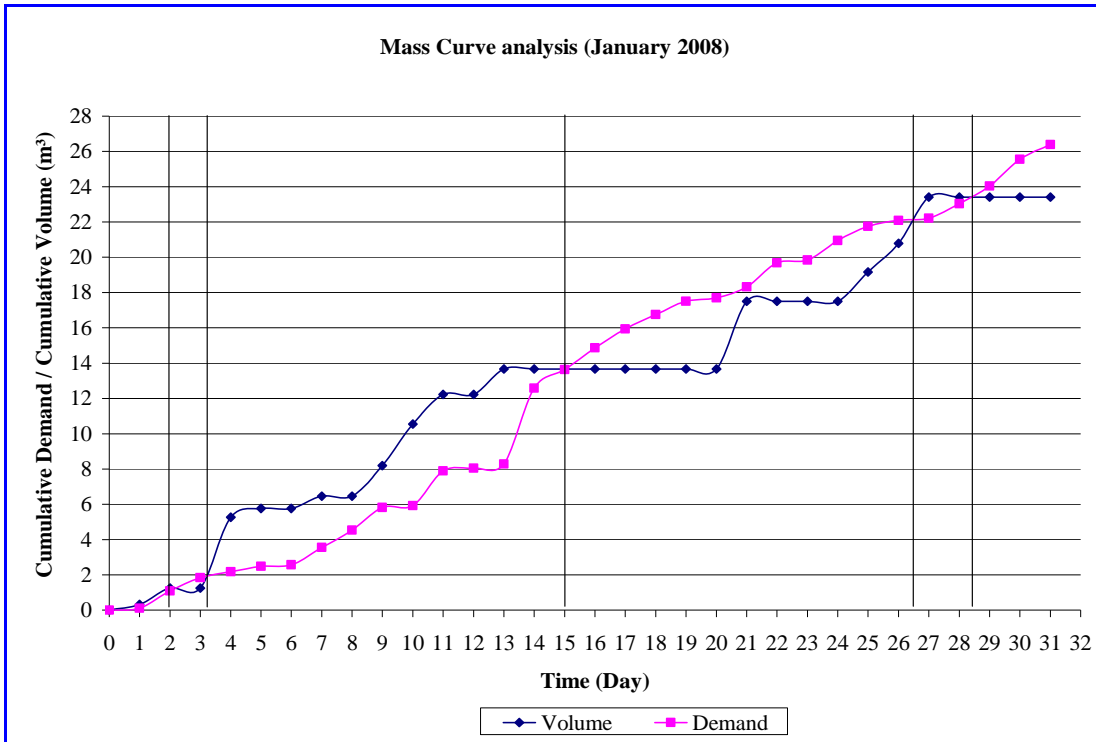


Figure 12: Mass curve analysis for the month of January 2008-08-18

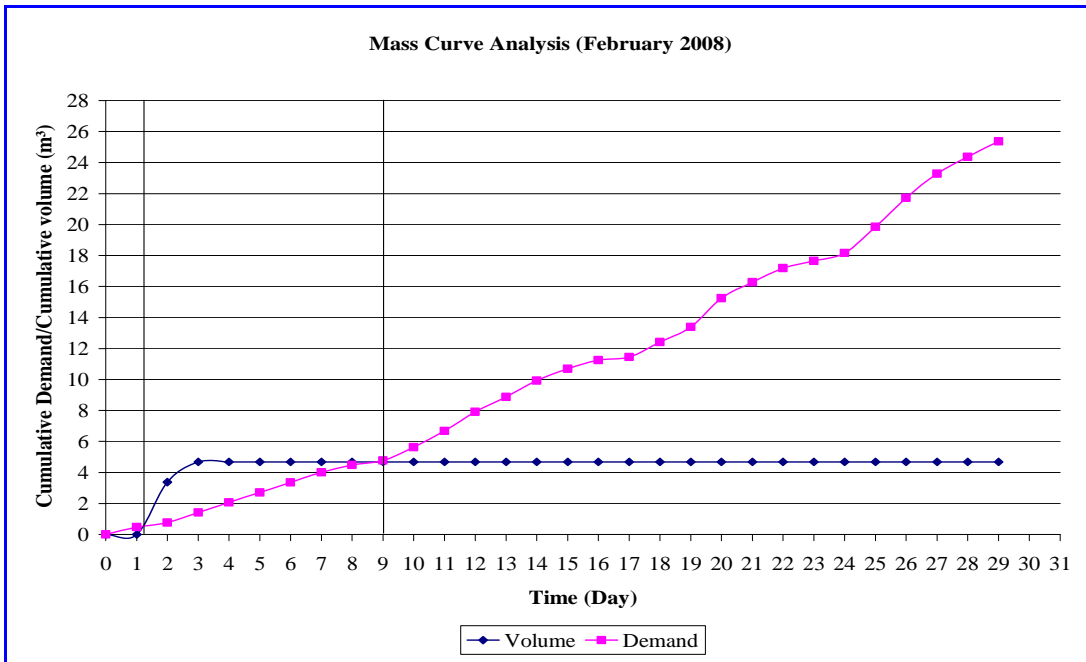


Figure 13: Mass curve analysis for the month of February 2008

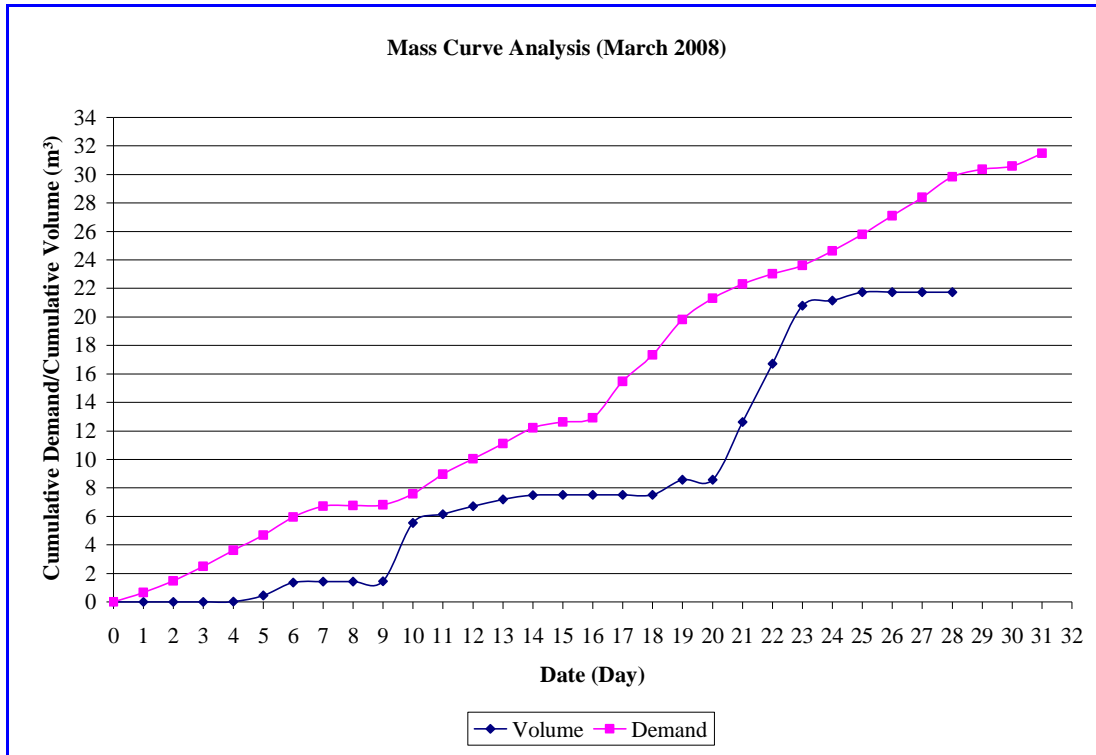


Figure 14: Mass curve analysis for the month of March 2008

Data concerning rainwater volume and water consumption (mainly for flushing toilet) is used to assess the reliability of the rainwater harvesting system. The following equation is proposed to determine the daily reliability of the system:

$$R = \frac{V_a}{V_d} \times 100 \quad (8)$$

where R is daily reliability of the system (%), V_a is daily collected rainwater volume (m^3/day) and V_d is daily water consumption for flushing the toilet (m^3/day).

Equation (8) is applied to assess the reliability of the system and it is found that the reliability for the studied period ranges from 26.61 % to 100 %. The average reliability is found to be 80 %. Figure 15 shows the reliability of rainwater harvesting system for three months.

Figure 16 shows the relationship between the daily reliability and rainfall depth. The relationship is found to be logarithmic and the value of coefficient of determination (R^2) is 0.4962. According to Ghisi et al (2006), the coefficient of determination for such relationship is not high and this is attributed to wide variation in the reliability.

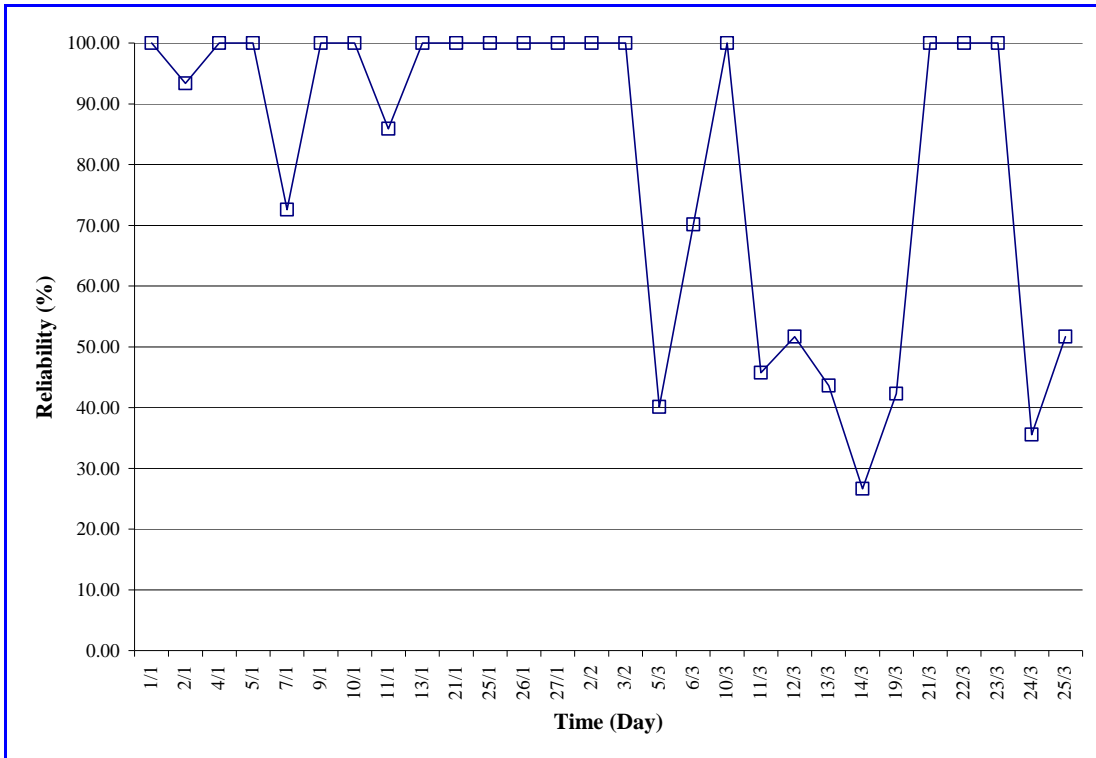


Figure 15: Reliability of the system for the period of study

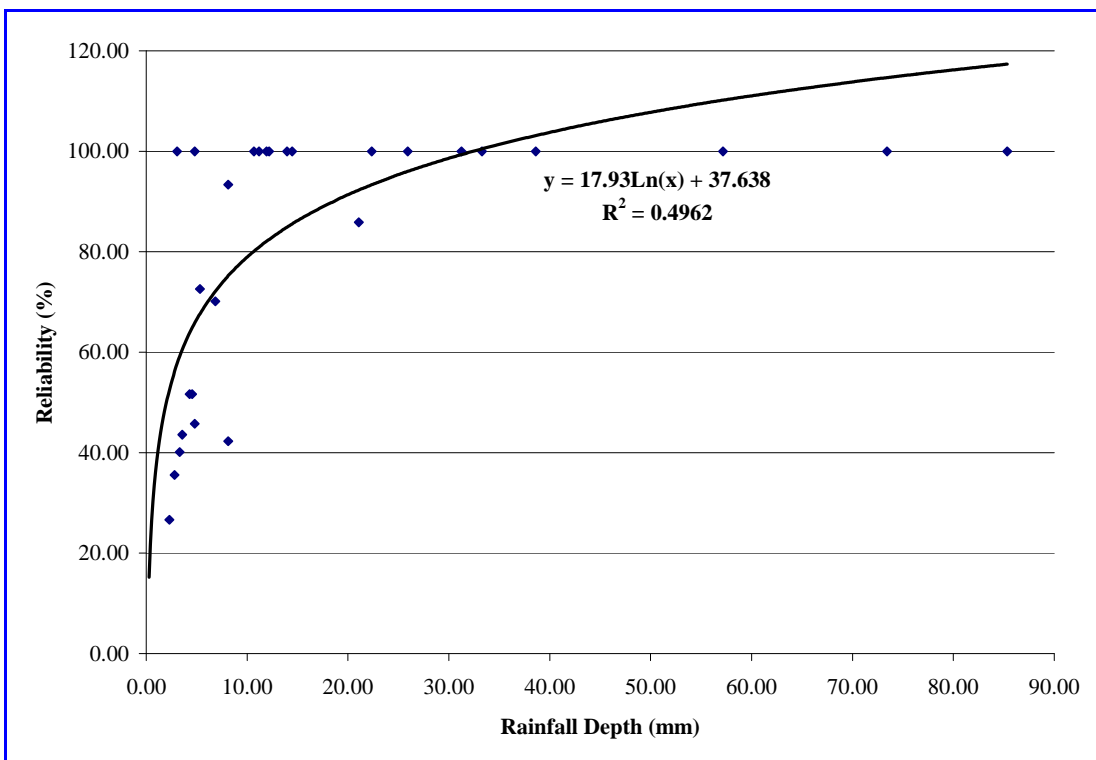


Figure 16: Correlation between reliability and rainfall depth

Summary and Conclusions

In the present study, a rainwater harvesting system is installed at a selected location at the Faculty of Engineering, Universiti Putra Malaysia. The collected data from the system include rainwater volume, rainfall depth and water consumption for toilet flushing. The data is used to simulate the relationship between collected rainwater volume in the tank and rainwater depth. Also, the data is used to assess the reliability of the system and to determine the runoff coefficient for the roof (catchment).

Based on the collected data it is found that the runoff coefficient is found to be 0.83 and this value is within the acceptable range for the roof material. For the period of the study, volume of rainwater collected in the tank of the system ranges from 0.027 m³ to 4.03 m³.

The proposed model can be used to predict the collected rainwater volume with reasonable accuracy and the t-test revealed that the model predictions are within 95% level of confidence.

The reliability of rainwater harvesting system is determined and it is ranges between 18.5% and 100% depending on rainfall pattern and water consumption.

References

- Ghisi E and Ferreira D. F. (2006). "Savings by Using Rainwater and Grey Water in a Multi Storey Residential Building in Southern Brazil" *Journal of Potential for Potable Water*.
- Gould J. and Nissen-Petersen, E. (1999). "Rainwater Catchment Systems for Domestic Supply" *Intermediate Technology Pubs, UK*.
- Handia L, Tembo, J.M., Mwindwa, C. (2002) "Potential of Rainwater Harvesting in Urban Zambia" *proceedings of 3rd Water Net/Warfsa Symposium, Dar Es-Salaam*.
- Rahman M. M., Fatima J., (2006). "Challenges for Implementation of Rain Water Harvesting Project in Arsenic Affected Areas of Bangladesh" *Department of Civil Engineering, Bangladesh University of Engineering and Technology (BUET), Dhaka, Bangladesh*.
- Ruslan.H,(2003). " Rainwater Harvesting: Reliability Analyses for Large Buildings:Factory,Government and Commercial Complex", *Universiti Teknologi MARA, Shah Alam, Malaysia*.
- Zhu Q., Liu C. (1998). "Rainwater Utilization for Sustainable Development of Water Resources in China" *Proceedings of Stockholm Water International Symposium, Stockholm, Sweden*.
- Shaaban, A. J., Kardi J., and Awang, S. (2002). "Rainwater Harvesting and Utilization System for A Double Story Terrace House at Taman Wangsa Melawati, Kuala Lumpur" *A Workshop of Rainwater Harvesting as a Tool for Sustainable Water Supply and Stormwater Management, Kuala Lumpur, Malaysia*.